


**NOTES:**

1. IF DISTANCE FROM MAIN TO HOUSE EXCEEDS 200 FEET, OR NOT ON SIDE CLOSEST TO WATER MAIN. METER CHAMBER INSTALLATION IS REQUIRED (SEE METER CHAMBER INSTALLATION DETAIL, DS-2)
2. IF SIDEWALK EXISTS IN FRONT OF HOUSE, CURB BOX SHALL BE INSTALLED BETWEEN ROAD AND SIDEWALK.
3. WATER SERVICE SHALL BE INSTALLED IN A TRENCH SEPARATE FROM THE SANITARY LATERAL MAINTAIN 10 FEET MINIMUM HORIZONTAL SEPARATION FROM ANY SEWER LATERAL, SEPTIC TANK OR DRAINAGE FIELD.
4. ANY PRIVATE WATER SUPPLY (i.e. WELL) CAN NO LONGER BE UTILIZED TO SUPPLY WATER TO THE SAME BUILDING AS IS PROPOSED TO BE SUPPLIED BY THE PUBLIC WATER SYSTEM, THEREFORE SAID PRIVATE WATER SUPPLY MUST BE CUT AND CAPPED AT THE BASEMENT WALL AND AT THE WELL CASING.
5. LARGER SERVICES REQUIRED (i.e. 1 1/4", 1 1/2" OR 2") BY OWNER/DEVELOPER SHALL BE APPROVED BY THE MOHAWK VALLEY WATER AUTHORITY ENGINEERING DEPARTMENT.
6. OWNER /PLUMBER TO PLUMB ALL 3/4" OR 1" COPPER SERVICES WITH 1/2" FEMALE ADAPTERS, AND/OR OTHER FITTINGS TO ACCEPT THE 1/2" MALE COUPLINGS THAT ARE SUPPLIED BY THE MOHAWK VALLEY WATER AUTHORITY TO SET A 5/8" METER. METER OPENING REQUIRED TO SET WITH COUPLINGS IS 13 1/2".

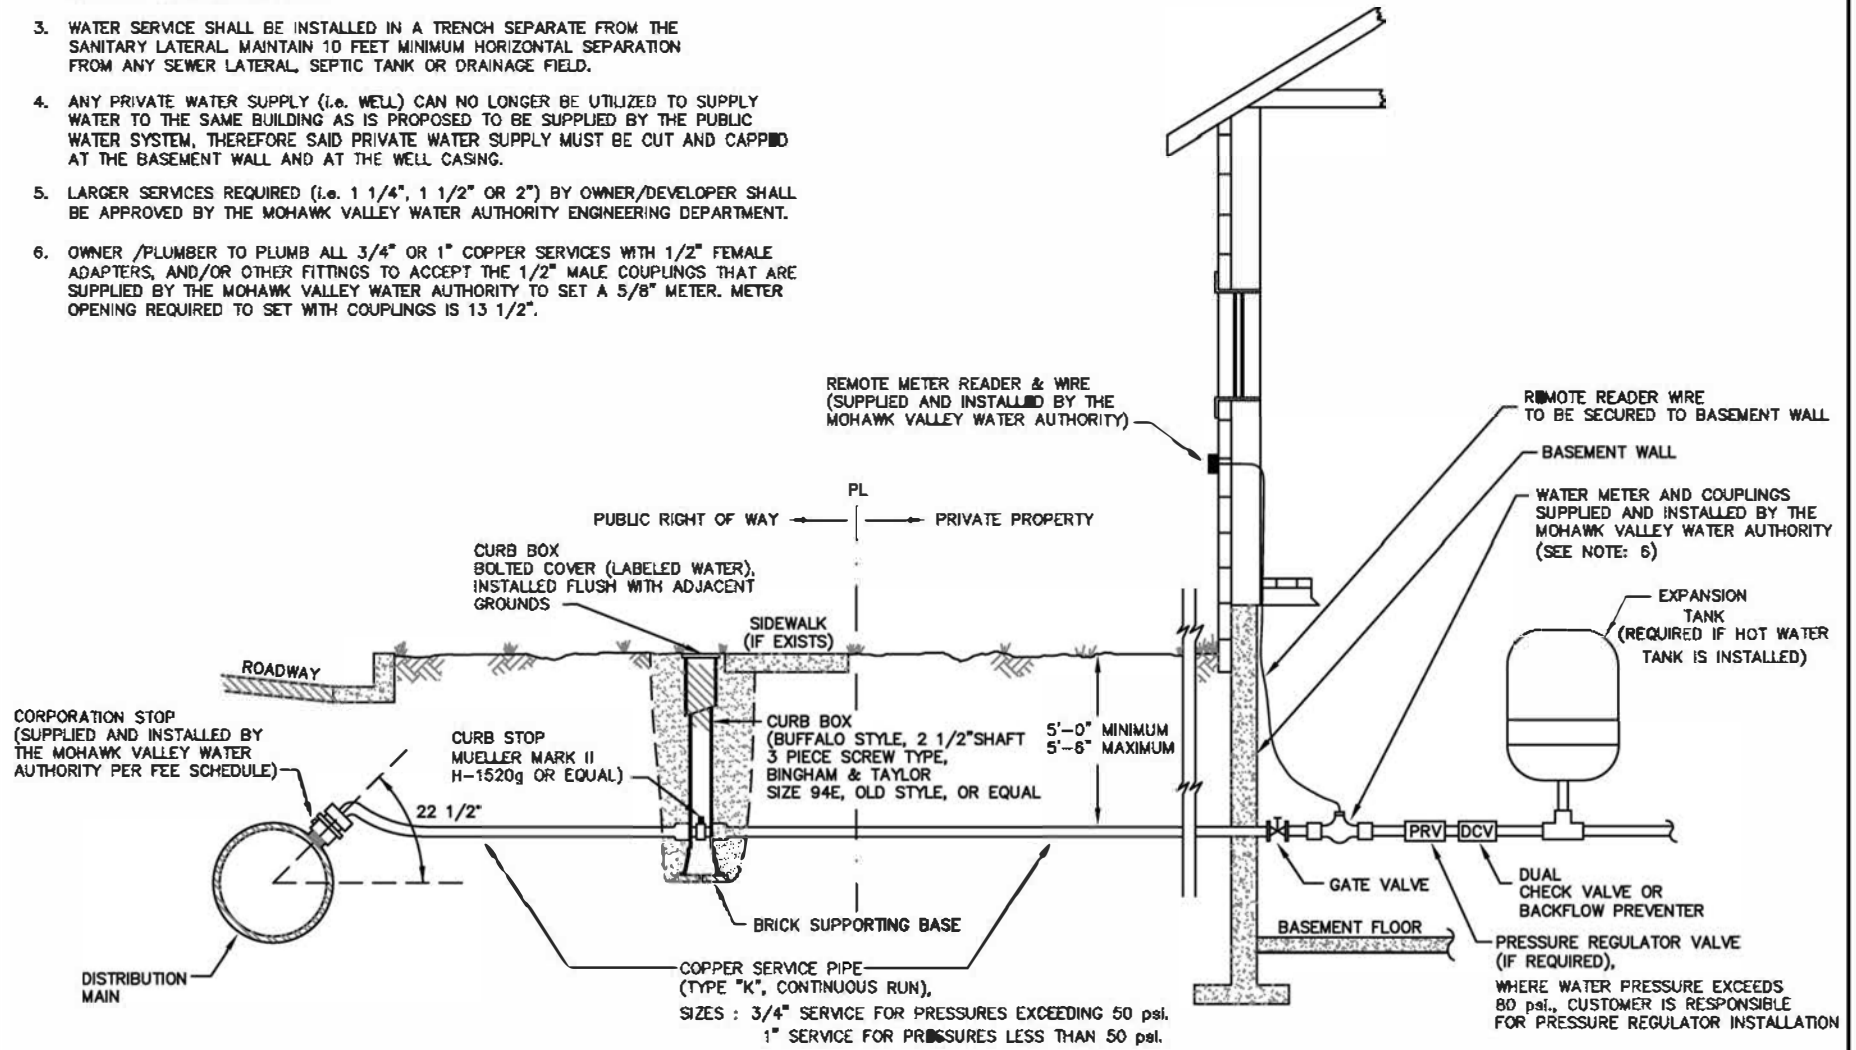

NOT TO SCALE