


**NOTES:**

1. TRENCH EXCAVATION SHALL COMPLY WITH OSHA 29 CFR 1926 SUBPART P EXCAVATION STANDARD
2. EXCAVATED MATERIAL SHALL BE PLACED A MINIMUM OF 2 FEET FROM TRENCH EDGE
3. FOR ALL PIPE MIN. WIDTH = OUTSIDE DIAMETER + 2 FEET
4. M.V.W.A. SHALL PLACE VALVE MARKER ON FINAL VALVE LOCATION AS VERIFIED BY OWNER'S REPRESENTATIVE
5. A 10 FOOT MIN. HORIZONTAL DISTANCE SHALL BE MAINTAINED BETWEEN THE WATER MAIN AND ANY SANITARY SEWER OR STORM DRAINAGE PIPE. AT LOCATIONS WHERE THE WATER MAIN AND SANITARY SEWER OR STORM DRAINAGE LINES CROSS EACH OTHER, A MINIMUM CLEAR DISTANCE OF 18" SHALL BE MAINTAINED. IF THESE DISTANCES CANNOT BE MET THEN AN IMPERVIOUS MATERIAL CAN BE USED, SUCH AS NEW YORK STATE-ITEM 17203.80M-CONTROLLED LOW STRENGTH MATERIAL (CLSM).

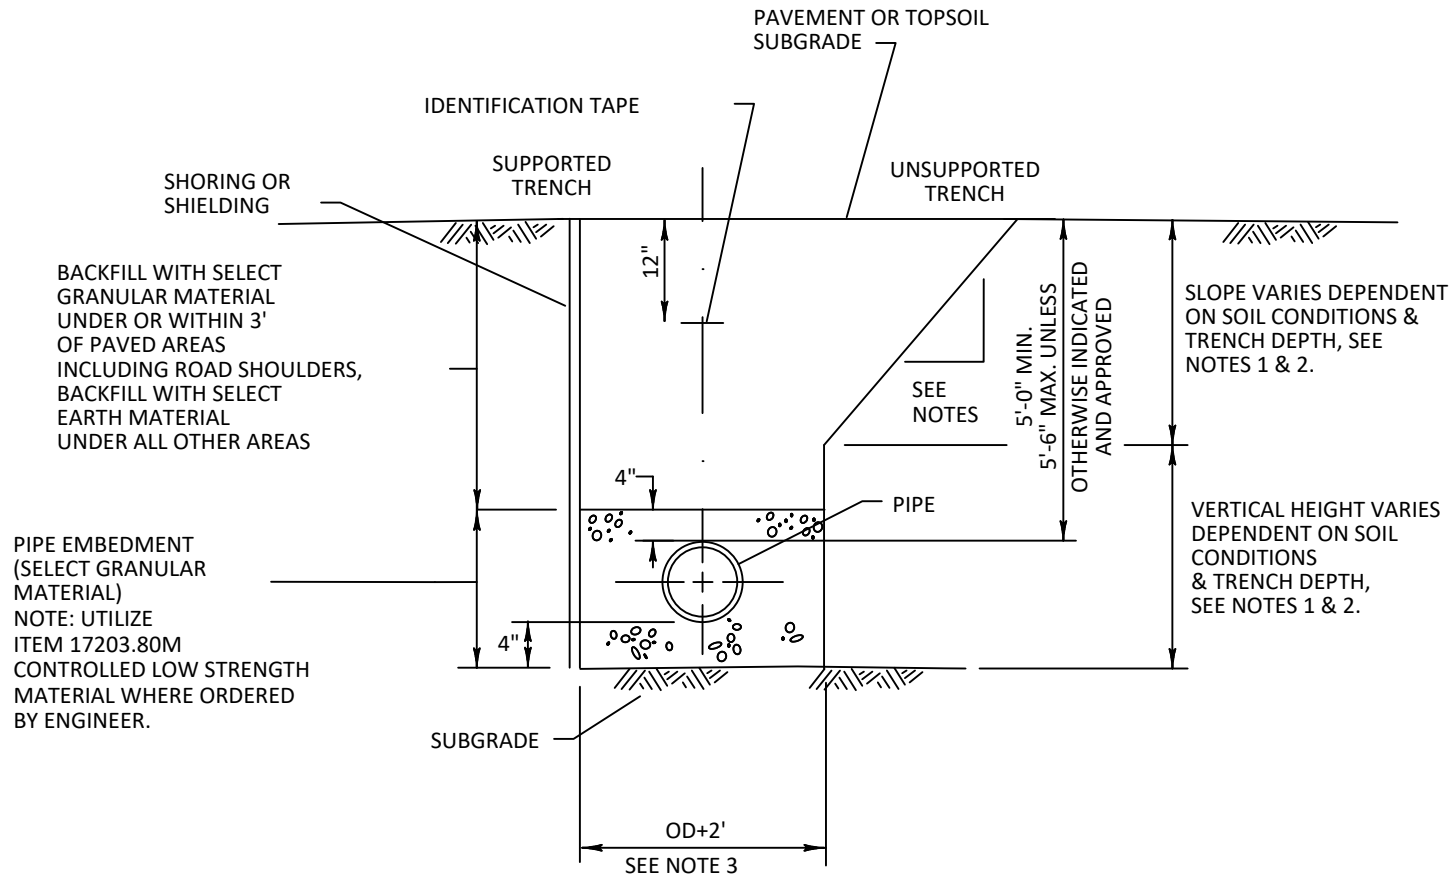

NOT TO SCALE

# STANDARD TRENCH DETAIL